SIEMENS

Preface	
	4
Properties	1
Parameters	2
Diagnostics	3
Analog value representation	4
Connecting	5

SIMATIC

ET 200S distributed I/O 4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)

Manual

Safety Guidelines

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

DANGER

indicates that death or severe personal injury will result if proper precautions are not taken.

indicates that death or severe personal injury may result if proper precautions are not taken.

with a safety alert symbol, indicates that minor personal injury can result if proper precautions are not taken.

CAUTION

without a safety alert symbol, indicates that property damage can result if proper precautions are not taken.

NOTICE

indicates that an unintended result or situation can occur if the corresponding information is not taken into account.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

Qualified Personnel

The device/system may only be set up and used in conjunction with this documentation. Commissioning and operation of a device/system may only be performed by **qualified personnel**. Within the context of the safety notes in this documentation qualified persons are defined as persons who are authorized to commission, ground and label devices, systems and circuits in accordance with established safety practices and standards.

Prescribed Usage

Note the following:

WARNING

This device may only be used for the applications described in the catalog or the technical description and only in connection with devices or components from other manufacturers which have been approved or recommended by Siemens. Correct, reliable operation of the product requires proper transport, storage, positioning and assembly as well as careful operation and maintenance.

Trademarks

All names identified by [®] are registered trademarks of the Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

(A)

Preface

Purpose of the manual

This manual supplements the *ET 200S Distributed I/O System* Operating Instructions. General functions for the ET 200S are described in the *ET 200S Distributed I/O System* Operating Instructions.

The information in this document along with the operating instructions enables you to commission the ET 200S.

Basic knowledge requirements

To understand these operating instructions you should have general knowledge of automation engineering.

Scope of the manual

This manual applies to this ET 200S module. It describes the components that are valid at the time of publication.

Recycling and disposal

Thanks to the fact that it is low in contaminants, this ET 200S module is recyclable. For environmentally compliant recycling and disposal of your electronic waste, please contact a company certified for the disposal of electronic waste.

Additional support

If you have any questions relating to the products described in these operating instructions, and do not find the answers in this document, please contact your local Siemens representative.

http://www.siemens.com/automation/partner

The portal to our technical documentation for the various SIMATIC products and systems is available at:

http://www.siemens.com/automation/simatic/portal

The online catalog and ordering system are available at: http://www.siemens.com/automation/mall

Training center

We offer courses to help you get started with the ET 200S and the SIMATIC S7 automation system. Please contact your regional training center or the central training center in D - 90327, Nuremberg, Germany. Phone: +49 (911) 895-3200.

http://www.siemens.com/sitrain

Technical Support

You can reach technical support for all A&D projects

- using the support request web form: http://www.siemens.com/automation/support-request
- Phone: + 49 180 5050 222
- Fax: + 49 180 5050 223

For more information about our technical support, refer to our Web site at http://www.siemens.de/automation/service

Service & Support on the Internet

In addition to our documentation services, you can also make use of our comprehensive online knowledge base on the Internet.

http://www.siemens.com/automation/service&support

There you will find:

- Our Newsletter, which constantly provides you with the latest information about your products.
- The right documentation for you using our Service & Support search engine.
- The bulletin board, a worldwide knowledge exchange for users and experts.
- Your local contact for Automation & Drives in our contact database.
- Information about on-site services, repairs, spare parts. Lots more can be found on our "Services" pages.

Table of contents

	Prefac	e	3
1	Prope	ties	7
	1.1	4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)	7
2	Param	eters	11
	2.1	Parameters	11
	2.2	Parameter description	12
3	Diagno	ostics	13
	3.1	Diagnostics using LED display	13
	3.2	Error types	14
4	Analog	y value representation	15
	4.1	Introduction	15
	4.2	Analog value representation for measuring range with SIMATIC S7	15
	4.3	Measuring ranges	16
	4.4 4.4.1 4.4.2	Effect on analog value representation Effect of the supply voltage and the operating state on analog input values Effect of the value range on the 4AI I 2WIRE ST analog input	17
5	Conne	cting	19
	5.1	Connecting measuring sensors	19
	5.2	Wiring unused channels of the analog input modules	21
	5.3	Using the shield connection	21
	Index.		23

Table of contents

Properties

1.1 4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)

Properties

- 4 inputs for measuring current
- Input range:
 - 4 to 20 mA, resolution 13 bits

General terminal assignment

Note

Terminals A4, A8, A3 and A7 are only available on certain terminal modules.

	Terminal assignment for 4AI I 2WIRE ST (6ES7134-4GD00-0AB0)										
Terminal Assignment Terminal Assignment Notes											
1	M0+	5	M1+	• M _{n+} : Input signal "+", Channel n							
2	Mo-	6	M ₁₋	 M_n.: Input signal "-", Channel n 							
3	M ₂₊	7	M3+	AUX1: Protective-conductor terminal or potential bus (freely usable							
4	M ₂₋	8	M ₃₋	up to 230 VAC)							
A4	AUX1	A8	AUX1								
A3	AUX1	A7	AUX1								

```
Properties
```

1.1 4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)

Usable terminal modules

Usable terminal modules for 4AI I 2WIRE ST (6ES7134-4GD00-0AB0)						
TM-E15C26-A1TM-E15C24-01(6ES7193-4CA50- 0AA0)(6ES7193-4CB30- 0AA0)		Spring terminal				
TM-E15S26-A1 TM-E15S24-01 (6ES7193-4CA40- (6ES7193-4CB20- 0AA0) 0AA0)		Screw-type terminal				
TM-E15N26-A1 (6ES7193-4CA80- 0AA0)	TM-E15N24-01 (6ES7193-4CB70- 0AA0)	Fast Connect				
$\begin{array}{c} 1 \\ 0 \\ 0 \\ 1 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\$	$\begin{array}{c} 1 \\ 0 \\ 1 \\ 0 \\ 2 \\ 0 \\ 3 \\ 0 \\ 4 \\ 1 \\ 0 \\ 0$	Wiring examples M+ mA M- M- 2-wire measuring transducer is supplied by means of the measuring circuits.				

Block diagram

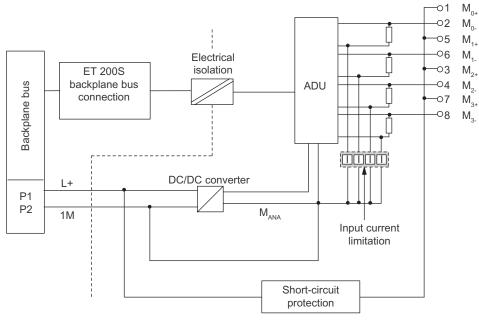


Figure 1-1 Block diagram of the 4AI I 2WIRE ST

1.1 4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)

4AI I 2WIRE ST technical specifications (6ES7134-4GD00-0AB0)

Dimensions and weight										
Width (mm)	15									
Weight	Approx. 40 g									
Module-specific data										
Supports isochronous operation	No									
Number of inputs	4									
Cable length										
Shielded	Max. 200 m									
Parameter length	7 bytes									
Address space	8 bytes									
Voltages, curr	ents, potentials									
Rated load voltage L+ (from the power module)	24 VDC									
Reverse polarity protection	Yes									
Power supply of the transducers	Yes									
Short-circuit protection	Yes (approx. 200 mA for module)									
Electrical isolation										
Between the channels and backplane bus	Yes									
Between the channels and load voltage L+	No									
Between the channels	No									
Permissible potential difference										
- Between M_{ANA} and the backplane bus (U_{\text{iso}})	75 V DC, 60 V AC									
Insulation tested	500 VDC									
Current consumption of the module										
• From the load voltage L+ (with sensor supply)	Max. 125 mA									
Power dissipation of the module	Typically 0.6 W									
Status, interru	pts, diagnostics									
Diagnostics function										
Group error	Red "SF" LED									
Diagnostic functions readable	Yes									
Analog valu	e generation									
Measuring principle	Integrative									
Integration and cycle time/resolution per channel:										
Integration time can be assigned parameters	Yes									
Interference frequency suppression in Hz	60 50									
Integration time in ms	16,7 20									
Cycle time per module in ms	33 40									
Resolution (including overshoot range)	4 to 20 mA/13 bits									

4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0) Manual, 04/2007, A5E01076074-01

1.1 4AI I 2WIRE ST analog electronic module (6ES7134-4GD00-0AB0)

Suppression of interf	erence, limits of error			
Noise suppression for $f = n \times (f1 \pm 1\%)$, (f1 = interference frequency)				
 Common mode interference (peak value of interference < rated value of input range) 	Min. 70 dB			
Crosstalk between the inputs	Min50 dB			
Operational limit (in the entire temperature range, with reference to the input range)	± 0,4 %			
Basic error limit (operational limit at 25°C with reference to input range)	± 0,3 %			
Temperature error (with reference to the input range)	± 0.003 %/K			
Linearity error (with reference to the input range)	± 0,01 %			
Repeatability (in steady state at 25°C with reference to input range)	± 0,05 %			
Data for select	cting a sensor			
Input range (rated value)/input resistance				
Current	4 to 20 mA/25 Ω			
Permitted input current (destruction limit)	Approx. 30 mA (limited	electronically)		
Load of the two-wire measuring transducer	Max. 750 Ω			
Smoothing of the measured values	Yes, can be assigned p	parameters in 4 steps		
	Step	Time constant		
	None	1 x cycle time		
	Weak	4 x cycle time		
	Medium	16 x cycle time		
	Strong	32 x cycle time		

Parameters

2.1 Parameters

4AI I 2WIRE ST	Range of values	Default setting	Applicability
Group diagnostics (parameter	Disable	Disable	Module
assignment error, internal error)	Enable		
Diagnostics: Overflow/underflow	Disable	Disable	Module
	Enable		
Diagnostics:	Disable	Disable	Channel
Wire break	Enable		
Smoothing	None	None	Channel
	• Weak		
	Medium		
	Strong		
Type/range of measurement	Deactivated	2WIRE: 4 to 20 mA	Channel
	• 2WIRE: 4 to 20 mA		

Table 2-1 Parameters for analog input module

2.2 Parameter description

Smoothing

The individual measured values are smoothed by digital filtering. The smoothing can be adjusted in four steps, in which the smoothing factor k multiplied with cycle time of the electronic module equals the time constant of the smoothing filter. The higher the smoothing the greater the time constant of the filter.

The following diagrams show the step response with the various smoothing factors depending on the number of module cycles.


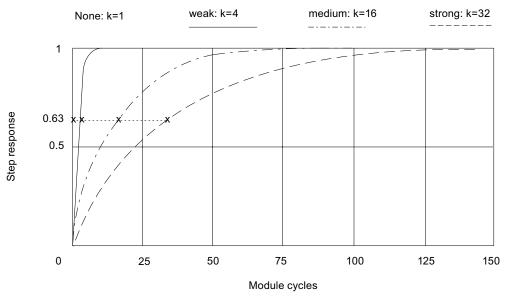


Figure 2-1 Smoothing with 4AI I 2WIRE ST

Diagnostics

3.1 Diagnostics using LED display





① Batch error (red)

Status and error displays

Event (LED)	Cause	Remedy
SF		
On	No configuration or incorrect module plugged in. No load voltage.present There is a diagnostic message.	Check the parameter assignment. Check the load voltage. Evaluate the diagnostics.

3.2 Error types

3.2 Error types

Analog input module error types

	Error type	Meaning	Remedy			
16 _D	10000: Parameter assignment error	Module cannot use the parameter for the channel:	Correct the configuration (align actual and set configuration).			
		Inserted module does not match the one configured.	Correct the parameter assignment (wire break			
		Incorrect parameter assignment.	diagnostics only parameterized for the permitted measuring ranges).			
9 _D	01001: Error	Internal module error (diagnostic message at channel 0 applies to the entire module)	Replace the module.			
7 _D	00111: Upper limit exceeded	Value is above the overshoot range.	Correct the module/final controlling element tuning.			
8 D	01000: Lower limit value undershot	Value is below the underrange.	Correct the module/final controlling element tuning.			
6 _D	00110: Open circuit	Line to the encoder interrupted.	Correct the process wiring.			

Table 3-1 Error types

4

Analog value representation

4.1 Introduction

Electronic modules with analog outputs

With the electronic module with analog inputs, continuously variable signals, such as those occurring in temperature measurement and resistance measurement, can be acquired, evaluated, and converted to digital values for further processing.

4.2 Analog value representation for measuring range with SIMATIC S7

Analog value representation

With the same nominal range, the digitized analog value is the same for input and output values. Analog values are represented in two's complement.

The following table shows the analog value representation of the analog electronic modules.

Resolution	Analog value															
Bit number	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Significance of the bits	S	214	2 ¹³	2 ¹²	2 ¹¹	2 ¹⁰	2 ⁹	28	27	2 ⁶	25	24	2 ³	2 ²	2 ¹	20

Table 4-1 Analog value representation (SIMATIC S7 format)

Sign

The sign (S) of the analog value is always in bit number 15:

- "0" → +
- "1" → -

4.3 Measuring ranges

Output value

The following table shows the representation of the binary analog values and the corresponding decimal and hexadecimal representation of the units of the analog values.

The table below shows the resolutions 11, 12, 13, and 15 bit + sign. Each analog value is entered left aligned in the ACCU. The bits marked with "x" are set to "0".

Resolution in bits Units Analog value Hexadecimal Decimal High byte Low byte 11+S 16 10н S0000000 001xxxx 12+S 8 8н S0000000 0001xxx 4 13+S 4_H S0000000 00001xx 1 15 + sign 1н S000000 000001

Table 4-2 Output values (SIMATIC S7 format)

4.3 Measuring ranges

Introduction

The following tables contain the digitized analog values for the measuring ranges of the analog input modules.

Since the binary representation of the analog values is always the same, these tables only compare the measuring ranges with the units.

Measuring ranges for current: 4 to 20 mA

Table 4-3	SIMATIC S7 format: Measuring range 4 to 20 mA
-----------	---

Measuring range	Ui	nits	Range
4 mA to 20 mA	Decimal	Hexadecimal	
> 22,8142	32767	7FFF _H	Overflow
22,8142	32511	7EFF _H	
:	:	:	Overshoot range
20,0005	27649	6C01н	
20,0000	27648	6C00 _H	
16,0000	20736	5100н	
:	:	:	Nominal range
4,0000	0	0н	
3,9995	-1	FFFFH	
	:	:	Undershoot range
1,1852	-4864	ED00 _H	
< 1,1852	-32768	8000н	Underflow

4.4 Effect on analog value representation

Measured values in the event of a wire break in relation to enabled diagnostics

The following additional information applies to the current measuring range 4 to 20 mA:

Format		Parameter assignment ¹	Measured values			Description	
			Decimal	Hexadecimal			
S7	•	"Wire break" diagnostics enabled	32767	7FFF _H	•	"Open circuit" diagnostic message	
	•	"Wire break" diagnostics disabled "Overflow/underflow" diagnostics enabled	-32767	8000 _H	•	Measured value after leaving the underrange	
					•	"Lower limit value undershot" diagnostic message	
	٠	"Wire break" diagnostics disabled	-32767	8000 _H	•	Measured value after leaving the	
	•	"Overflow/underflow" diagnostics disabled				underrange	
¹ Measu	iring	g range limits for wire break and under	flow detection: A	At 1.185 mA	1		

 Table 4-4
 Measured values in the event of a wire break in relation to enabled diagnostics

4.4 Effect on analog value representation

4.4.1 Effect of the supply voltage and the operating state on analog input values

The input values of the analog modules are dependent on the supply voltage for electronics/encoders and on the operating state of the PLC (CPU of the DP master). This is illustrated by the table below.

Table 4-5	Relationship between the analog input values for the operating state of the PLC (CPU of
	the DP master) and the supply voltage L+

	ate of the PLC DP master)	Supply voltage L+ on ET 200S (power module)	Input value of the electronic module with analog inputs (evaluation possible on the CPU of the DP master)	
POWER ON	RUN	L+ present	Process values	
			$7FFF_H$ until first conversion after startup, or after assignment of parameters for the module is completed.	
		L+ missing	7FFF _H	
POWER ON	STOP	L+ present	Process value	
		L+ missing	7FFF _H	
POWER OFF	-	L+ present	-	
		L+ missing	-	

4.4 Effect on analog value representation

4.4.2 Effect of the value range on the 4AI I 2WIRE ST analog input

The way electronic modules respond to analog inputs depends on where the inputs values fall within the value range. This is illustrated by the table below.

Table 4-6 Response of the analog modules, depending on where the analog input value falls within the range of values

Measured value within	Input value in SIMATIC S7 format	Input value in SIMATIC S5 format	
Nominal range	Measured value	Measured value	
Over-/Undershoot range	Measured value	Measured value	
Overflow	7FFF _H	End of the overshoot range +1 plus overflow bit	
Underflow	8000н	End of the underrange -1 plus overflow bit	
Before setting parameters or with faulty parameters ¹	7FFF _H	7FFF _H	

5

Connecting

5.1 Connecting measuring sensors

Introduction

You can connect current transmitters to the 4AI I 2WIRE ST analog input module to act as a:

• 2-wire transmitter

In this chapter you will find out how to connect the measuring encoders and what to watch out for when doing so.

Cables for analog signals

You should use shielded and twisted-pair cables for the analog signals. This reduces the effect of interference. You should ground the shield of the analog cables at both ends. If there are differences in potential between the ends of the line, a compensating current flows via the shield that can interfere with the analog signals. If this is the case, you should only ground the shield at one end of the line.

Analog input modules

The analog input modules are electrically isolated:

- Between logic and backplane bus.
- No isolation: Link between MANA and central grounding point

Note

Ensure that this difference in potential U_{ISO} does not exceed the permitted value.

Connection of measuring encoders to analog inputs

Generally speaking, however, when connecting two-wire transmitters for current measurement, you should not make a connection from M- to M_{ANA}. This also applies to inputs that have been assigned parameters correspondingly but unused.

Connecting

5.1 Connecting measuring sensors

Abbreviations used


The meanings of the abbreviations in the figures below are as follows:

- M+ Measuring line (positive)
- M Measuring line (negative)
- M Ground connection
- L + Rated load voltage 24 V DC

Isolated measuring encoders

The isolated measuring encoders are not connected to the local ground potential. These can be potential-free.

The following schematic representation illustrates the connection of isolated measuring encoders to the analog input modules.

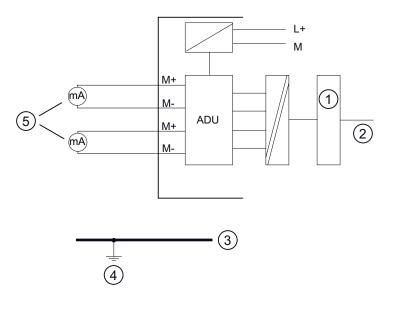

- 1 Logic
- ② Backplane bus
- ③ Ground bus
- ④ Central grounding point
- Isolated measuring encoders

Connecting

5.2 Wiring unused channels of the analog input modules

5.2 Wiring unused channels of the analog input modules

Rules

Pay attention to the following instructions when wiring unused channels:

- "Disable" unused input channels when setting parameters.
- A deactivated channel always returns the value 7FFFH.
- The cycle time remains unchanged with the standard module 4AI I 2WIRE.

5.3 Using the shield connection

Rules

To prevent interference we recommend the following with the analog electronic modules:

- Use shielded wires to the sensors and actuators.
- Lay out the wire shields on the shield connection.
- Connect the shield connection with low impedance to the ground bus.

Connecting

5.3 Using the shield connection

Index

4

4AI I 2WIRE ST analog electronic module Block diagram, 8 Properties, 7 Technical data, 9 Terminal assignment, 7

Α

Analog input modules Error types, 14 Analog value representation, 19

В

Basic knowledge requirements, 3

С

Cables for analog signals, 19 Connecting, 19 Connection of measuring encoders to analog inputs, 19

D

Disposal, 3

I

Internet Service & Support, 4 Isolated measuring encoders, 20

L

LED display, 13

Μ

Measured value resolution, 16 Measuring encoders, 19 Measuring ranges with SIMATIC S7, 15

Ρ

Parameters for analog electronic modules, 11

R

Recycling, 3 Response of the analog modules, 17 During operation, 17 When faults occur, 17

s

Scope Manual, 3 Service & Support, 4 Shield contact, 21 Smoothing, 12

Т

Technical Support, 4 Training center, 4 Index